


## 50 Gallon, 120 Gallon, and 2x120 Gallon Tank Setbacks

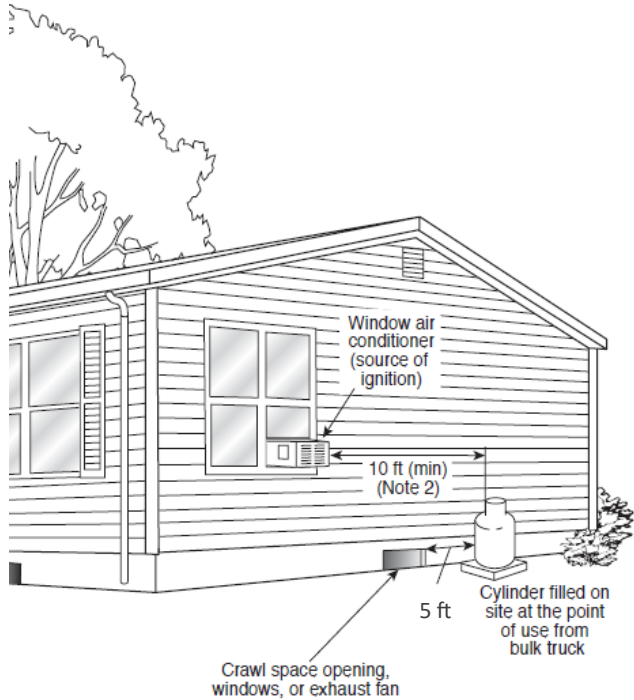

### Location Restrictions:

- At least 3 feet from any window that is higher than the tank
- At least 10 feet from anything electrical (meter, outlet, etc.)
- At least 10 feet from any venting (dryer vent, kitchen vent, HVAC vent, etc.)
- At least 10 feet from any light, generator, AC unit, condenser, wire, ignition source, etc.
- At least 1 foot from the property line
- Tank(s) must be set within 100 feet from point of delivery vehicle
- If within 10 feet of a driveway, crash protection will be required via jersey barriers or bollards
- At least 5 feet from any door or window that is positioned below the top of the tank

### Tank Dimensions

