


Underground Tank Setbacks

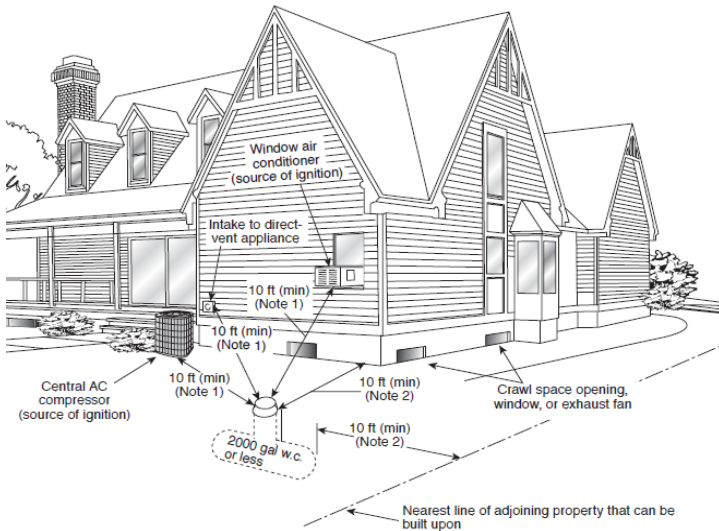


Location Restrictions

- 10 feet from house, any generator or other appliance, and 10 feet from the property line
- If within 10 feet from a driveway, crash protection will be required
- Tank must be set within 100 feet from point of delivery vehicle

House-Mounted Regulator Restrictions

- 3 feet from any window or door
- 5 feet from any vent, anything electrical, or any basement window

Excavation Guidelines

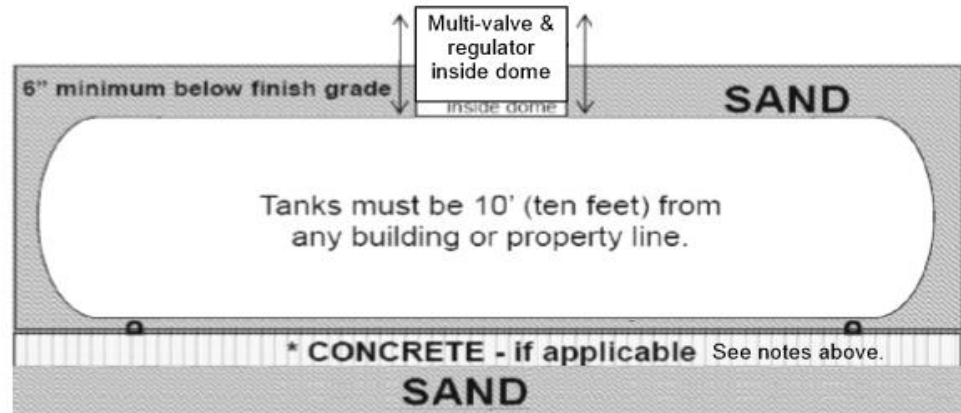

Tank Type:	500 Gallon	1000 Gallon	500 Gallon (With Concrete Pad)	1000 Gallon (With Concrete Pad)
Hole Dimensions (LxW)	12'x5'	18'x5'	12'x7'	18x7'
Hole Depth Before Sand	5'6"	5'9"	5'6"	5'9"
Amount of Sand Needed (Bottom of Hole)	6"	6"	2"	2"
Gas Line Trench Specifications: AT LEAST 1'6" wide x 2' deep, base filled with 6" of sand, net depth 18"				
Backfill: Backfill the entire tankhole and trench with sand, once the tank and line's respective inspections are completed. Sand must be on site for tank & gas line inspections				
Our crane truck must be able to drive within 5 feet of the hole				

*If these directions aren't followed, and/or installation cancellations/rescheduling is needed as a result, additional charges will apply